



AIR FILTER TESTING LABORATORIES, INC.

4632 Old LaGrange Road • Buckner, Kentucky 40010

Phone (502) 222-5720 • Fax (502) 222-9881

ASHRAE STANDARD METHOD 52.1-1992 AIRFLOW -vs- INITIAL RESISTANCE; CLEAN DEVICE

DEVICE TESTED

Test Requested By	PERMATRON
Manufacturer	PERMATRON
Test Sample Procurement	FURNISHED BY MANUFACTURER
Product Name	BHC
Model No.	BHC
Dimensions	24 IN. H X 24 IN. W X 0.25 IN. D (NOMINAL)
Product Description	MEDIA TYPE - SYNTHETIC, POLYPROPYLENE

REPORT NO.
13807

TEST NO.
1

SHEET NO.
1


TEST RESULTS - see attached performance curves

Test Airflow Rate	2000	ft ³ /min (cfm)
Initial Resistance	0.070	in. w.g.

PERFORMANCE CURVES

CLEAN DEVICE

Airflow -vs- Initial Resistance

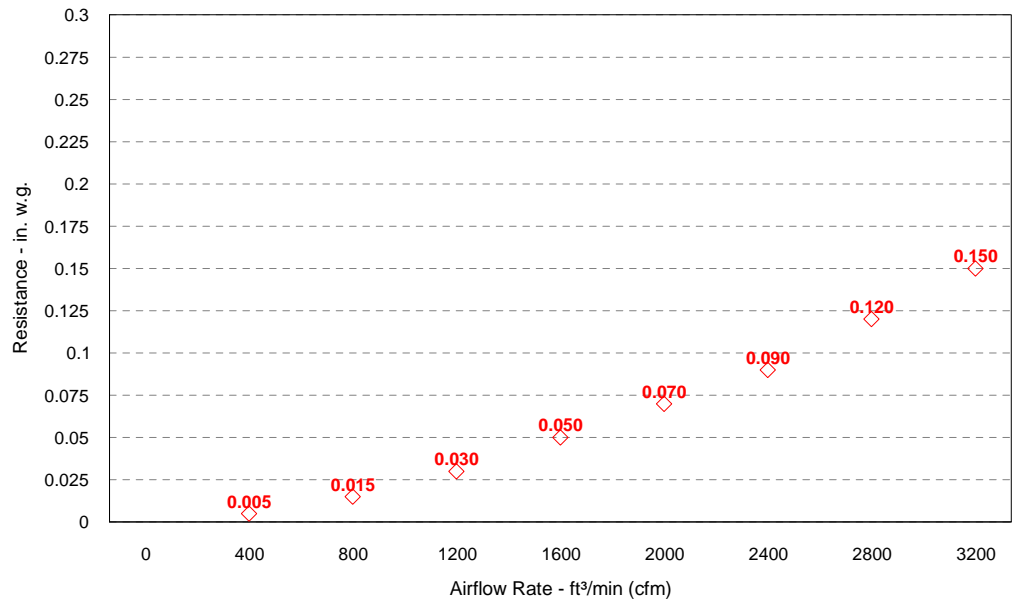

DATE
04-23-2009

TEST SUPERVISOR
M.A.M.

**ADMINISTRATIVE
APPROVAL**

Michael A. Murphy

